


**SECTION A-A**



**PLAN VIEW**

- NOTES:**
- 1). TYPE 11 CONDUIT JUNCTION WELL LID SHALL BE PRECAST POLYMER CONCRETE WITH A HEAVY-WEAVE FIBERGLASS FRAME. INSTALLED ON A PRECAST CONCRETE WELL.
  - 2). TYPE 11 CONDUIT JUNCTION WELL BODY SHALL BE PRECAST CONCRETE. AT LEAST ONE HOLE IN PRECAST WELLS WILL BE OF A 5" DIAMETER COMPLETELY THROUGH THE WALL. UNUSED HOLES SHALL BE PLUGGED.
  - 3). ALL CONDUIT JUNCTION WELLS PLACED IN PAVED AREAS SHALL BE CONSTRUCTED FLUSH WITH THE FINISHED GRADE. ALL CONDUIT JUNCTION WELLS PLACED IN UNPAVED AREAS SHALL BE CONSTRUCTED ABOVE FINISHED GRADE AND GRADED TO DRAIN AWAY FROM THE WELL, AS DETAILED.
  - 4). ALL CRACKS, GAPS, OR OPENING IN JUNCTION WELL WALL SHALL BE SEALED WITH CONCRETE.

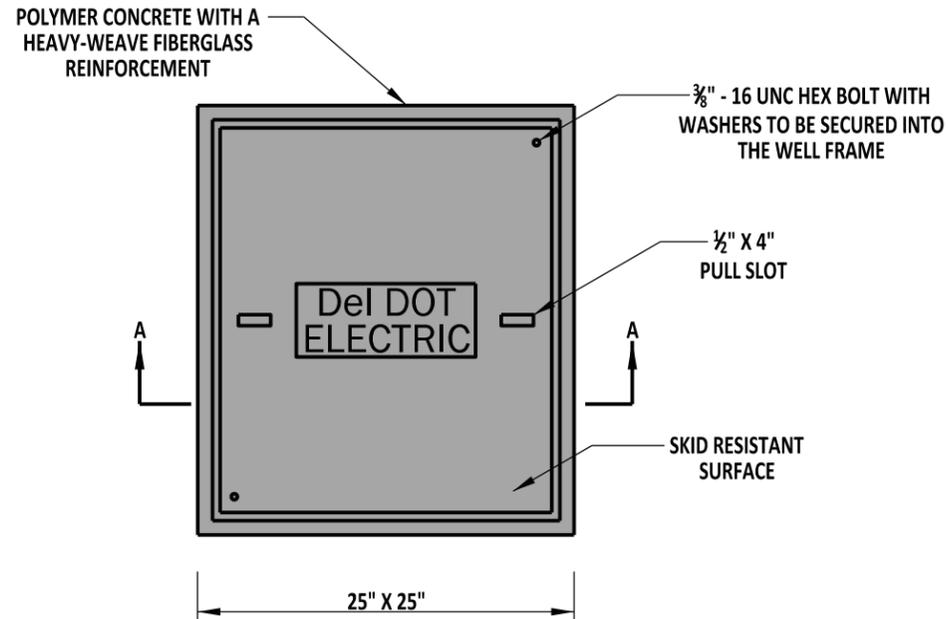

**DELAWARE**  
**DEPARTMENT OF TRANSPORTATION**

**CONDUIT JUNCTION WELL, TYPE 11**

STANDARD NO. T-3 (2013)      SHT. 1      OF      3

**APPROVED**

SIGNATURE ON FILE      02/14/2014  
CHIEF ENGINEER      DATE

**RECOMMENDED**

SIGNATURE ON FILE      01/14/2014  
DESIGN ENGINEER      DATE