


NOTES:

1. CONTRACTOR SHALL COORDINATE WITH CONECTIV FOR DISCONNECT OF EXISTING SERVICE AND INSTALLATION OF PROPOSED 100 AMP 120/240V SINGLE PHASE SERVICE FOR NAVIGATIONAL LIGHTS. CONTRACTOR SHALL PROVIDE 2-4" SCHEDULE 40 PVC CONDUITS FOR PROPOSED SERVICE. ALL WORK SHALL BE COMPLETED AS PER CONECTIV STANDARDS. CONTACT: GUY EBERWEIN (302) 934-3356
2. THE POWER COMPANY WILL FURNISH AND INSTALL TRANSFORMERS AND TRANSFORMER PADS. TRANSFORMERS SHALL HAVE 10 FT CLEARANCE IN THE FRONT AND 3 FT CLEARANCE TO THE SIDES AND BACK. CONECTIV WILL FURNISH THE PAD AND THE CONTRACTOR WILL INSTALL THE PAD. THE ELECTRICAL CONTRACTOR SHALL CONTACT THE POWER COMPANY TO COORDINATE INSTALLATION. CONTACT: GUY EBERWEIN, (302) 934-3356
3. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL SUFFICIENT SLACK IN THE SECONDARY CONDUCTORS AT THE TRANSFORMER FOR TERMINATION. THE ELECTRICAL CONTRACTOR SHALL FURNISH ALL REQUIRED SECONDARY CONDUCTOR TERMINATION HARDWARE FOR THE POWER COMPANY. THE POWER COMPANY SHALL INSTALL THE CONDUCTOR TERMINATORS AND TERMINATE ALL CONDUCTORS IN THE TRANSFORMER.
4. THE CONTRACTOR SHALL COORDINATE WITH THE UNITED STATES COAST GUARD - BM1 BEN BROWN OR CHIEF HUBER, (302) 227-2440, 7 DAYS IN ADVANCE OF DISCONNECTING POWER TO THE EXISTING NAVIGATIONAL LIGHTS. ALL WORK SHALL BE IN ACCORDANCE WITH THE RULES AND REGULATIONS SET FORTH BY THE COAST GUARD.
5. BAND RISER TO POLE WITH 3/4" STAINLESS STEEL BANDS AT 12" ABOVE DISCONNECT, 12" BELOW WEATHERHEAD, AND 60" MAX. INTERVALS IN BETWEEN.
6. METER SOCKET AND DISCONNECT SHALL BE Banded TO THE POLE.

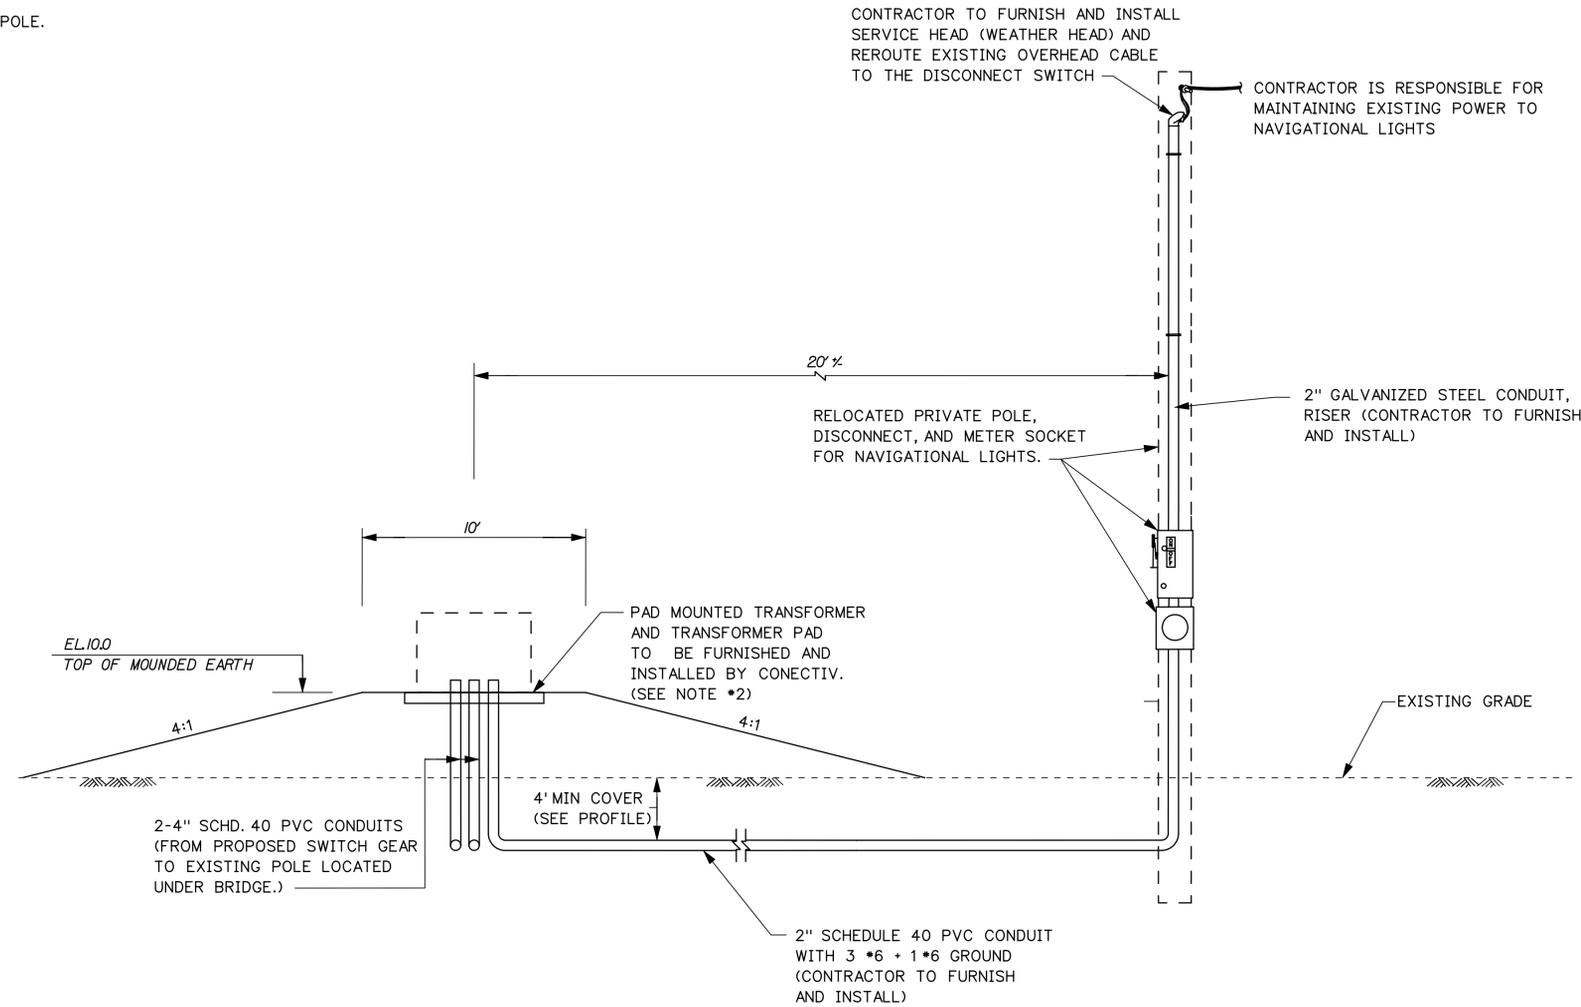

**TEMPORARY ELECTRICAL SERVICE DETAIL
FOR EXISTING NAVAGATIONAL LIGHTS**
NOT TO SCALE

DATE:	3-02-05	DESCRIPTION:	NEW SHEET	BY:	RK&K
-------	---------	--------------	-----------	-----	------

**DELAWARE STATE 'A' IK
INDIAN RIVER MA 'INA 'E-DEVELOPMENT
PHASE II - CONECTIV 'LANS**

DESIGNED BY: RK&K
DRAWN BY: RK&K
BUILDING NO. : N/A
DATE: FEBRUARY 11, 2005
SCALE: N/A
SHEET NO. : DETAIL 01
E. F. N. :