


**FOUNDATION DETAILS**

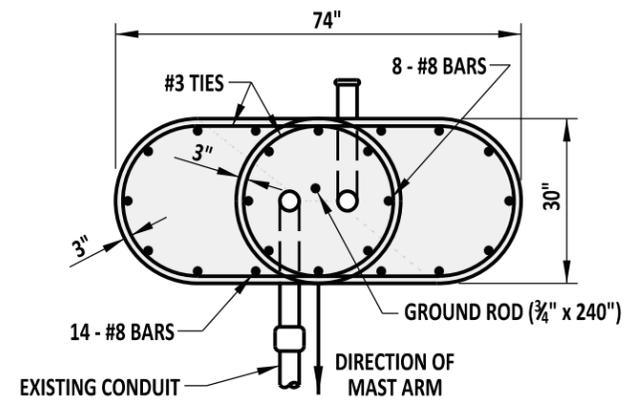

**SECTION A-A**

**NOTES:**

- 1). UNDERGROUND CONDUIT ENDS SHALL BE CAPPED WITH A GALVANIZED THREADED CONDUIT PLUG UNLESS CONNECTED TO AN EXISTING CONDUIT.
- 2). PLACE 2 EACH 6" x 1/2" P.V.C., SCHEDULE 40 (TYP) VENTS IN THE GROUT AS DIRECTED IN THE FIELD BY THE ENGINEER.



**DELAWARE**  
**DEPARTMENT OF TRANSPORTATION**

**SPECIAL POLE BASE**

STANDARD NO. T-6 (2011) SHT. 1 OF 1

**APPROVED**

SIGNATURE ON FILE  
CHIEF ENGINEER

12/22/2011  
DATE

**RECOMMENDED**

SIGNATURE ON FILE  
DESIGN ENGINEER

12/21/2011  
DATE